



# Waukesha Water Utility

SERVING WAUKESHA SINCE 1886

115 Delafield Street  
Waukesha, WI 53188-3615

~~~~~  
Telephone: (262) 521-5272 • Fax: (262) 521-5265 • E-mail: [contactus@waukesha-water.com](mailto:contactus@waukesha-water.com)

Re: Additional Water Meter

Dear Customer:

This letter is regarding your inquiry into an additional meter for your property. If you are interested in each unit having its own water meter, please complete the enclosed application and return it to our office with a check for \$130.00 for each additional meter you would like to install. **Please note that in order to complete the application, you will need to obtain a City plumbing permit and provide the permit number on the application form. The permit can be obtained at City Hall.**

The application tells us the number of water using devices located in each unit. We use the information to determine the size of the meter that will give you adequate water pressure and volume. After we have sized your meter and received payment, your plumber can begin working. The plumber should separate and label the plumbing for each unit and install a copper horn and stop for each meter you wish to install. You are responsible for the plumbing costs. The plumbing must be done in accordance with the Water Utility specifications. A copy of the specifications is attached.

When the plumber's work is complete, the Waukesha Water Utility can set the additional meters. Please schedule an appointment a week in advance, especially if you want the Utility to install the meter on the same day that the plumber's work is completed.

Finally, please note that if you decide to separate the plumbing, the water and waste (sewer) rates will apply to each meter.

If you have any further questions, please call us at (262) 521-5272 between 8:00 a.m. and 4:00 p.m.

Sincerely,

WAUKESHA WATER



# Waukesha Water Utility

## Application for Additional Water Meters

1. Property Address \_\_\_\_\_
2. # of additional meters needed \_\_\_\_\_ 3. Property is within: City of Waukesha    Town of Waukesha    City of Pewaukee
4. Existing well? Y N                      Do you intend to keep this well for watering the lawn? Y N
5. Type of building?    Single Family     Duplex     Triplex     Apartment (>4 units)     Condo
6. Owner's Name \_\_\_\_\_ Phone \_\_\_\_\_
7. Owner's Address \_\_\_\_\_
8. Plumber's Name \_\_\_\_\_ Phone \_\_\_\_\_
9. Plumber's Address \_\_\_\_\_
10. City Plumbing Permit # \_\_\_\_\_ 11. Who is responsible for payment?    Owner     Plumber


**Please note: This Application will not be accepted without the City Plumbing Permit Number.**

Please list the number of water using devices hooked up to each meter.

| Existing Meter         | New Meter #1           | New Meter #2           | New Meter #3           |
|------------------------|------------------------|------------------------|------------------------|
| Shower heads           | Shower heads           | Shower heads           | Shower heads           |
| Bathtubs               | Bathtubs               | Bathtubs               | Bathtubs               |
| Toilets – tank         | Toilets – tank         | Toilets – tank         | Toilets – tank         |
| Toilets - fast flush   | Toilets - fast flush   | Toilets - fast flush   | Toilets - fast flush   |
| Bidet                  | Bidet                  | Bidet                  | Bidet                  |
| Bathroom sink fixtures | Bathroom sink fixtures | Bathroom sink fixtures | Bathroom sink fixtures |
| Kitchen sink fixtures  | Kitchen sink fixtures  | Kitchen sink fixtures  | Kitchen sink fixtures  |
| Dishwasher outlets     | Dishwasher outlets     | Dishwasher outlets     | Dishwasher outlets     |
| Laundry tub fixtures   | Laundry tub fixtures   | Laundry tub fixtures   | Laundry tub fixtures   |
| Clothes washers        | Clothes washers        | Clothes washers        | Clothes washers        |
| ¾" Garden hose         | ¾" Garden hose         | ¾" Garden hose         | ¾" Garden hose         |
| ½" Garden hose         | ½" Garden hose         | ½" Garden hose         | ½" Garden hose         |
| Bar sink               | Bar sink               | Bar sink               | Bar sink               |
| Glass filler           | Glass filler           | Glass filler           | Glass filler           |
| Underground sprinkler  | Underground sprinkler  | Underground sprinkler  | Underground sprinkler  |
| Combination fixture    | Combination fixture    | Combination fixture    | Combination fixture    |
|                        |                        |                        |                        |
|                        |                        |                        |                        |
|                        |                        |                        |                        |

Your Signature \_\_\_\_\_ Date \_\_\_\_\_

# WATER LATERAL & MULTIPLE METER SET SPECIFICATIONS

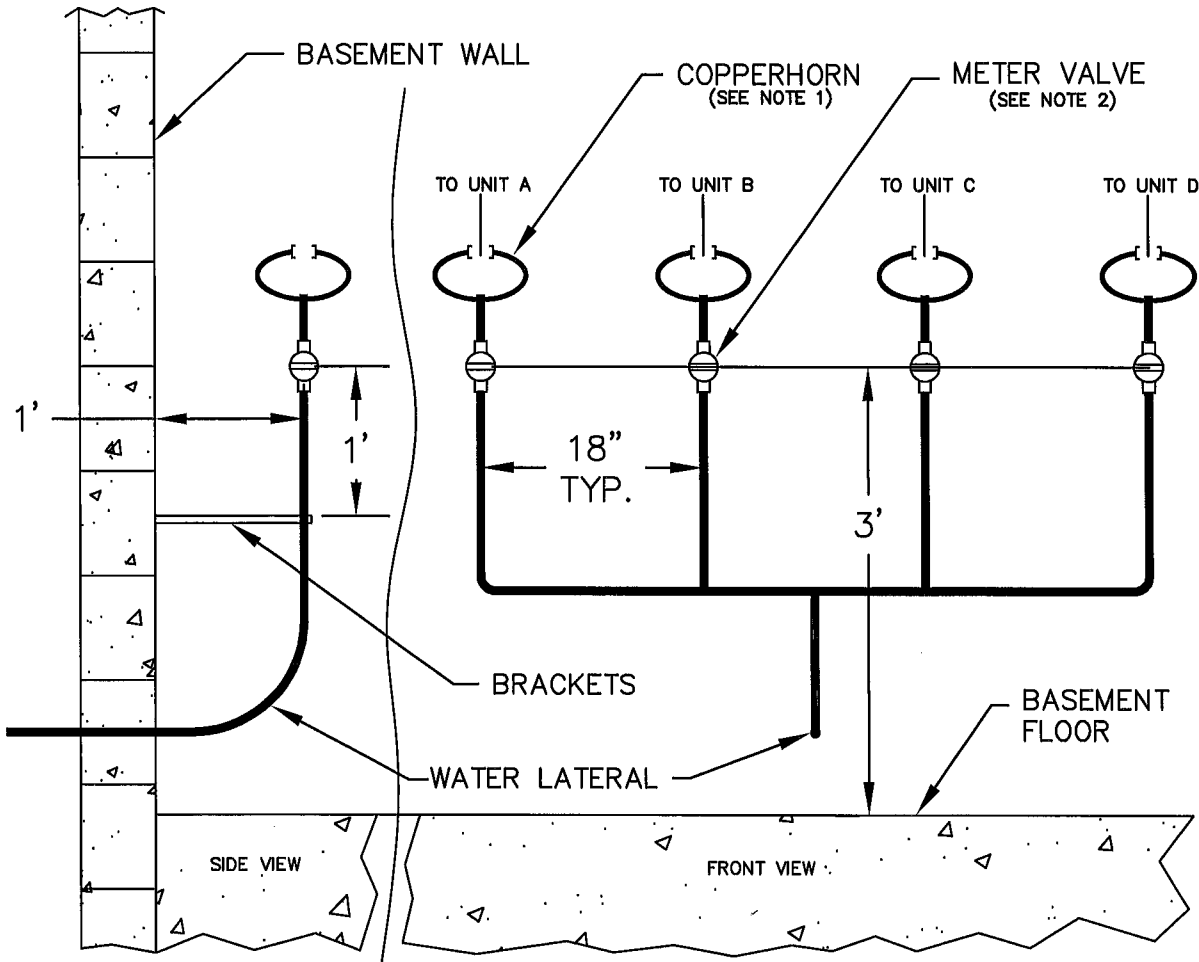

**NOTE 1:** Copperhorns shall comply with ANSI/AWWA C-800, have a lead free brass body with copper arms and swivel connections manufactured by Ford in the following sizes.

| Meter Size | Copperhorn                     |
|------------|--------------------------------|
| 5/8"       | No. 1 provided with union nuts |
| 3/4"       | No. 3 provided with union nuts |
| 1"         | No. 4 provided with union nuts |

**NOTE 2:** The meter valve shall be a curb stop valve and comply with ANSI/AWWA C-800. All brass must be lead free. All valves must include tracer wire attachment points. The following meter valves are approved:

| Comprasion Copper to Iron (C-I)               |
|-----------------------------------------------|
| Mueller H-15172 – tracer wire attachment      |
| Ford B41-XXX-TW-Q – tracer wire attachment    |
| A.Y. McDonald 6102 Q – tracer wire attachment |

**NOTE 3:** If the wrong meter valve and/or copperhorn are installed, the Waukesha Water Utility will install the correct meter valve and/or copperhorn. The cost for any corrections will be billed to the applicant as outlined in the current Waukesha Water Utility fee schedule.

**NOTE 4:** The Waukesha Water Utility Rules and Regulations Manual requires that the meter must have a four foot (4') clearance around the entire meter.

**NOTE 5:** No ball valves are allowed. All brass must be lead free.